





T H E G C M E T H O D


Free Air Cooler



*Secondary
Refrigeration
Chiller*




Coils & Shared Piping Runs

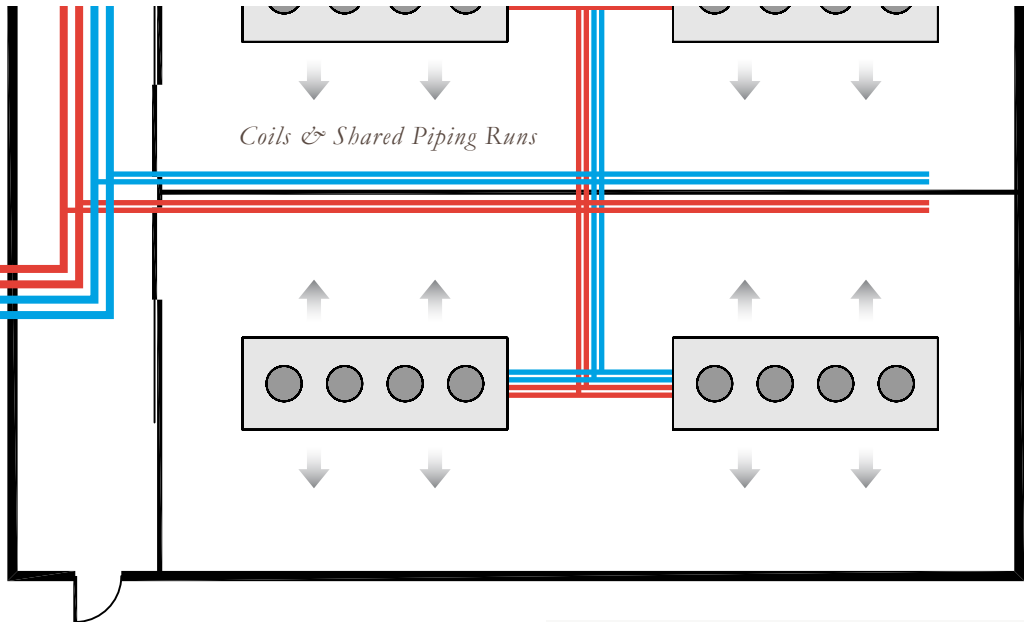


PLAN VIEW

Dual Discharge Coil on Ceiling in Room

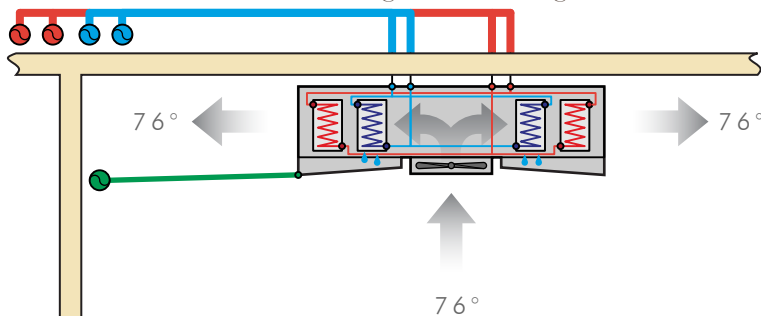

TRADITIONAL RH CONTROL vs GC REHEAT METHOD

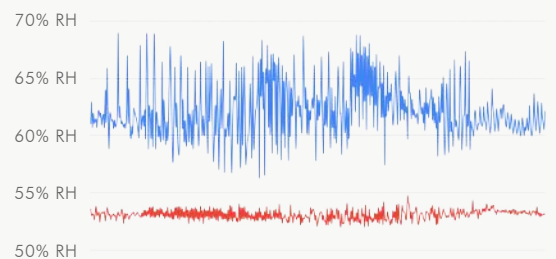

- ▣ Cooling Coil Creates Condensation
- ▣ Room Air Dehumidifies via Condensate Drain
- ▣ Warm Coil Reheats Cool Air for Minimal Temperature Change

SECTION VIEW

© 2020 GROW CONTROLLED, LLC. ALL RIGHTS RESERVED. CONTACT US FOR MORE INFORMATION.



G R O W C O N T R O L L E D , L L C
100 APPLEWOOD DRIVE SPARTA MICHIGAN · SODUS NEW YORK · UNION GAP WASHINGTON · PADDOCK WOOD UK
T 616.256.0420 · F 616.887.1128 · INFO@GROWCONTROLLED.COM · GROWCONTROLLED.COM




T H E G C M E T H O D



Lights Hang Below Coils for Maximum Canopy Height



Slim-Line Coil with even Less Vertical Impact

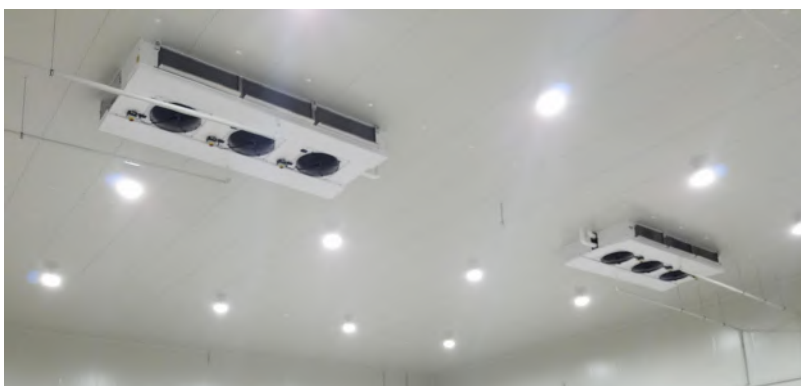

Low Profile V-Flow Dual-Discharge Coils use Less Space and Improve Airflow



Back-to-Back Coil Arrangement over Aisle in Room



Chiller with Free Cooler Option using Outdoor Temperatures for Cooling

© 2020 GROW CONTROLLED, LLC. ALL RIGHTS RESERVED. CONTACT US FOR MORE INFORMATION.



G R O W C O N T R O L L E D , L L C
100 APPLEWOOD DRIVE SPARTA MICHIGAN · SODUS NEW YORK · UNION GAP WASHINGTON · PADDOCK WOOD UK
T 616.256.0420 · F 616.887.1128 · INFO@GROWCONTROLLED.COM · GROWCONTROLLED.COM